

IT

**KIT ALLACCIAMENTO ANTERIORE  
VICTRIX OMNIA IN INCASSO  
COD. 3.028418**

**AVVERTENZE GENERALI.**

*Tutti i prodotti Immergas sono protetti con idoneo imballaggio da trasporto.*

*Il materiale deve essere immagazzinato in ambienti asciutti ed al riparo dalle intemperie.*

*Il presente foglio istruzioni contiene informazioni tecniche relative all'installazione del kit Immergas. Per quanto concerne le altre tematiche correlate all'installazione del kit stesso (a titolo esemplificativo: sicurezza sui luoghi di lavoro, salvaguardia dell'ambiente, prevenzioni degli infortuni), è necessario rispettare i dettami della normativa vigente ed i principi della buona tecnica.*

*L'installazione o il montaggio improprio dell'apparecchio e/o dei componenti, accessori, kit e dispositivi Immergas potrebbe dare luogo a problematiche non prevedibili a priori nei confronti di persone, animali, cose. Leggere attentamente le istruzioni in corredo del prodotto per una corretta installazione dello stesso. L'installazione e la manutenzione devono essere effettuate in ottemperanza alle normative vigenti, secondo le istruzioni del costruttore e da parte di personale abilitato nonché professionalmente qualificato, intendendo per tale quello avente specifica competenza tecnica nel settore degli impianti, come previsto dalla Legge.*

**Nel Kit è presente il necessario per effettuare l'allacciamento anteriore della caldaia a condensazione Victrix Omnia in incasso.**

**INSTALLAZIONE DEL KIT.**

Montare il gruppo allacciamento come rappresentato in figura 1 avendo cura di interporre le relative guarnizioni.

**N.B.:** ultimato il montaggio procedere con la verifica della prova di tenuta del circuito gas e del circuito idraulico.

IE

**FRONT CONNECTION KIT  
VICTRIX OMNIA IN RECESSED  
COD. 3.028418**

**GENERAL WARNINGS.**

*All Immergas products are protected with suitable transport packaging.*

*The material must be stored in a dry place protected from the weather.*

*This instruction manual provides technical information for installing the Immergas kit. As for the other issues related to kit installation (e.g. safety in the workplace, environmental protection, accident prevention), it is necessary to comply with the provisions specified in the regulations in force and with the principles of good practice.*

*Improper installation or assembly of the Immergas appliance and/or components, accessories, kits and devices can cause unexpected problems for people, animals and objects. Read the instructions provided with the product carefully to ensure proper installation.*

*Installation and maintenance must be performed in compliance with the regulations in force, according to the manufacturer's instructions and by professionally qualified staff, meaning staff with specific technical skills in the plant sector, as envisioned by the law.*

**The Kit enables boiler front connection for Victrix Omnia condensing boiler in recessed.**

**KIT INSTALLATION.**


Mount the connection unit as shown in fig. 1, taking care to correctly position the required seals.

**N.B.:** once assembly is complete, proceed with gas and water circuit resistance tests.

Composizione Kit		
Rif.	Descrizione	Quantità
1	Rubinetto gas G 1/2" M	1
2	Raccordo Vabco G 1/2"	1
3	Rubinetto sfera 1/2" M	1
4	Raccordo Vabco G 3/4"	2
5	Tubo CU D.18 gas kit allacc. ant. post.	1
6	Tubo CU D.14 uscita calda kit allacc. anteriore	1
7	Tubo CU D.14 entrata fredda kit allacc. anteriore	1
8	Tubo CU D.18 ritorno kit allacc. anteriore	1
9	Tubo CU D.18 mandata kit allacc. anteriore	1
10	Valvola sfiato manuale 1/8" M	1
11	Dado ottone 3/4" F	3
12	Dado ottone 1/2" F	1
13	Guarnizione 24x16x2	3
14	Guarnizione 18,5x11,5x2	2

Kit composition		
Ref.	Description	Quantity
1	G 1/2" M gas cock	1
2	G 1/2" Vabco fitting	1
3	1/2" M ball valve	1
4	G 3/4" Vabco fitting	2
5	CU D.18 front - rear connection kit gas pipe	1
6	CU D.14 hot water outlet front connection kit pipe	1
7	CU D.14 cold water inlet front connection kit pipe	1
8	CU D.18 return front connection kit pipe	1
9	CU D.18 flow front connection kit pipe	1
10	1/8" M manual air vent	1
11	3/4" F brass nut	3
12	1/2" F brass nut	1
13	24x16x2 flat gasket	3
14	18,5x11,5x2 flat gasket	2

Fig. 1

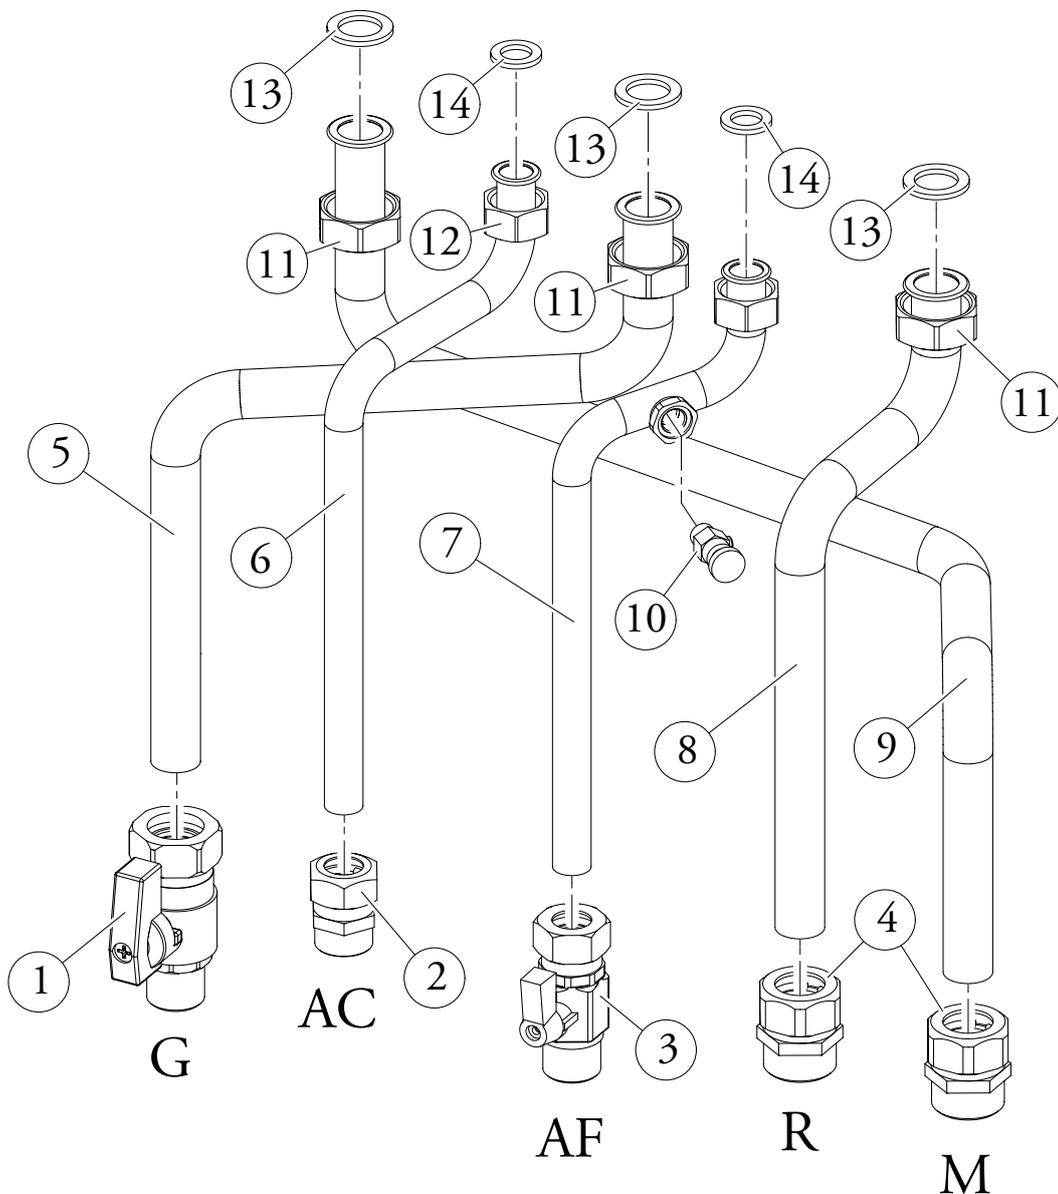

Legenda:  
M - Mandata impianto  
AC - Uscita acqua calda sanitaria  
G - Alimentazione gas  
AF - Entrata acqua sanitaria  
R - Ritorno impianto

Key:  
M - System flow  
AC - Domestic hot water outlet  
G - Gas supply 3/4"  
AF - Domestic cold water inlet  
R - System return 3/4"