

IT

KIT ALLACCIAMENTO DA DIMA DIN A DIMA IMMERGAS COD. 3.028209

PER MODELLI SERIE:

- VICTRIX OMNIA
- VICTRIX OMNIA V2

AVVERTENZE GENERALI.

Tutti i prodotti Immergas sono protetti con idoneo imballaggio da trasporto. Il materiale deve essere immagazzinato in ambienti asciutti ed al riparo dalle intemperie.

Il presente foglio istruzioni contiene informazioni tecniche relative all'installazione del kit Immergas. Per quanto concerne le altre tematiche correlate all'installazione del kit stesso (a titolo esemplificativo: sicurezza sui luoghi di lavoro, salvaguardia dell'ambiente, prevenzioni degli infortuni), è necessario rispettare i dettami della normativa vigente ed i principi della buona tecnica.

L'installazione o il montaggio improprio dell'apparecchio e/o dei componenti, accessori, kit e dispositivi Immergas potrebbe dare luogo a problematiche non prevedibili a priori nei confronti di persone, animali, cose. Leggere attentamente le istruzioni a corredo del prodotto per una corretta installazione dello stesso.

L'installazione e la manutenzione devono essere effettuate in ottemperanza alle normative vigenti, secondo le istruzioni del costruttore e da parte di personale abilitato nonché professionalmente qualificato, intendendo per tale quello avente specifica competenza tecnica nel settore degli impianti, come previsto dalla Legge.

Nel Kit è presente il necessario per effettuare l'allacciamento della caldaia a condensazione Victrix Omnia su dima Immergas.

INSTALLAZIONE DEL KIT.

Montare il kit allacciamento come rappresentato in figura 1 avendo cura di interporre le relative guarnizioni.

N.B.: ultimato il montaggio procedere con la verifica della prova di tenuta del circuito gas e del circuito idraulico.

IE

CONNECTION KIT FROM DIN TEMPLATE TO IMMERGAS TEMPLATE COD. 3.028209

FOR MODEL SERIES:

- VICTRIX OMNIA
- VICTRIX OMNIA V2

GENERAL WARNINGS.

All Immergas products are protected with suitable transport packaging. The material must be stored in a dry place protected from the weather.

This instruction manual provides technical information for installing the Immergas kit. As for the other issues related to kit installation (e.g. safety in the workplace, environmental protection, accident prevention), it is necessary to comply with the provisions specified in the regulations in force and with the principles of good practice.

Improper installation or assembly of the Immergas appliance and/or components, accessories, kits and devices can cause unexpected problems for people, animals and objects. Read the instructions provided with the product carefully to ensure proper installation.

Installation and maintenance must be performed in compliance with the regulations in force, according to the manufacturer's instructions and by professionally qualified staff, meaning staff with specific technical skills in the plant sector, as envisioned by the law.

The Kit enables boiler connection for Victrix Omnia condensing boiler to the Immergas template.

KIT INSTALLATION.


Mount the connection kit as shown in fig. 1, taking care to correctly position the required seals.

N.B.: once assembly is complete, proceed with gas and water circuit resistance tests.

Composizione Kit		
Rif.	Descrizione	Quantità
1	Tubo CU D.18 gas per dima Immergas	1
2	Tubo CU D.14 uscita calda per dima Immergas	1
3	Tubo CU D.14 entrata fredda per dima Immergas	1
4	Tubo CU D.18 ritorno per dima Immergas	1
5	Tubo CU D.18 mandata per dima Immergas	1
6	Dado ottone 3/4" F	3
7	Dado ottone 1/2" F	2
8	Rubinetto gas G 1/2" M	1
9	Raccordo Vabco G 1/2"	1
10	Rubinetto sfera 1/2" M	1
11	Raccordo Vabco G 3/4"	2
12	Guarnizione 24x16x2	3
13	Guarnizione 18,5x11,5x2	2

Kit composition		
Ref.	Description	Quantity
1	CU D.18 gas pipe for Immergas template	1
2	CU D.14 hot water outlet pipe for Immergas template	1
3	CU D.14 cold water inlet pipe for Immergas template	1
4	CU D.18 return pipe for Immergas template	1
5	CU D.18 flow pipe for Immergas template	1
6	3/4" F brass nut	3
7	1/2" F brass nut	2
8	G 1/2" M gas cock	1
9	G 1/2" Vabco fitting	1
10	1/2" M ball valve	1
11	G 3/4" Vabco fitting	2
12	24x16x2 flat gasket	3
13	18,5x11,5x2 flat gasket	2

Fig. 1

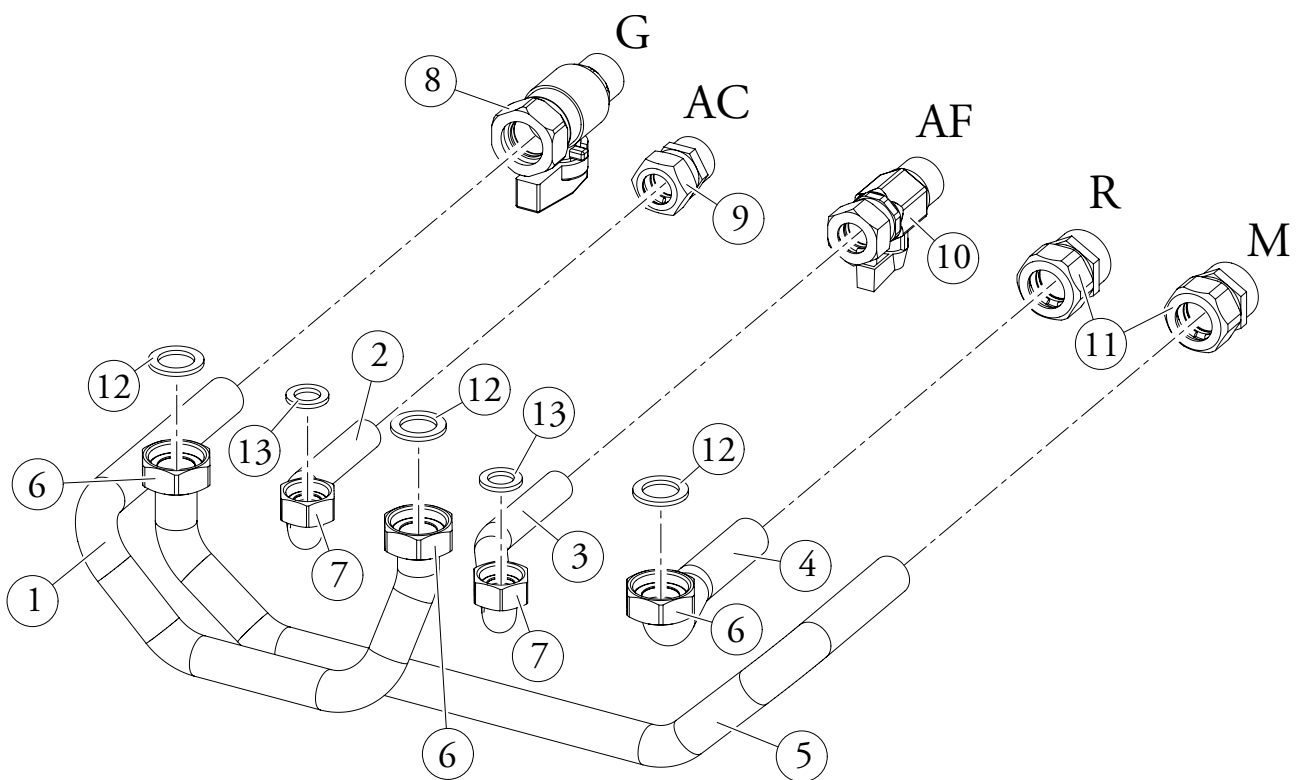

Legenda:
M - Mandata impianto
AC - Uscita acqua calda sanitaria
G - Alimentazione gas
AF - Entrata acqua sanitaria
R - Ritorno impianto

Key:
M - System flow
AC - Domestic hot water outlet
G - Gas supply 3/4"
AF - Domestic cold water inlet
R - System return 3/4"